


RX16KLFIS

Flush Mount Lift Rack

HUNTER
Engineering Company

SPECIFICATIONS []

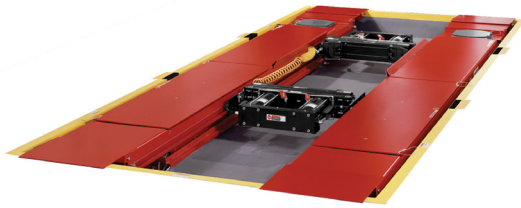


RX16KLFPS

Floor Pocket Requirements	Refer to <i>RF08115-00</i> for details
Power Requirements	208-230 VAC, single phase power, 26 Amp
Air Supply Requirements	130 - 150 psi (9 - 10.3 bar)
Minimum Concrete Spec.	3 in. (76 mm) thick, 3000 psi (20,700 kPa) rating
Maximum Floor Slope	2 in. (51 mm) over 126 in. (3200 mm)
Max Vehicle Weight	16,000 lbs. (7200 kg)
Alignment Height	All lock positions
Min. Four-Wheel Alignment	88 in. (2235 mm)
Lifting Speed	1 speed, 60 seconds
Lowering Speed	2 speed, 25 seconds
Max. Wheelbase	
General Service	201 in. (5105 mm)
Two-Wheel Alignment	195 in. (4953 mm)
Four-Wheel Alignment	168 in. (4013 mm)

Feature	KLFIS
6000-lb Swing Air Jacks (2)	✓
Two-Speed Lowering	✓
FIA Fully Integrated Alignment	✓
POWER SLIDE	✓
INFLATION STATION	✓

Dimension	
Outside Width (W1)	96.5 in. (2451 mm)
Inside Width (W2)	40 in. (1016 mm)
Length (L)	237 in. (6020 mm)
Runway Width (R)	26 in. (660 mm)
Raised Height (H1)	70 in. (1778 mm)
Depth (H2)	12.5 - 13 in. (318 - 330 mm)

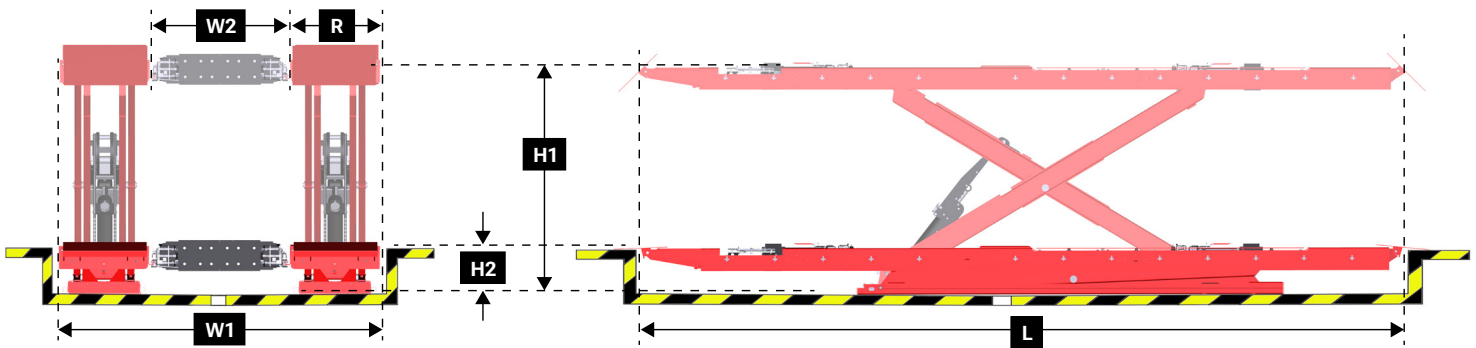

For lift rack information visit:
hunter.com/alignment-racks

For local contact visit:
hunter.com/contact

For general inquiries visit:
www.hunter.com or call 800-448-6848


Because of continuing technological advancements, specifications, models and options are subject to change without notice.

Form RS08134-00, 05-24
Supersedes Form RS08134-00, 06-23
Copyright ©2024, Hunter Engineering Company

RX16KLFIS

Flush Mount Lift Rack

LAYOUT DIAGRAM (refer to RF08115-00 for construction drawings)

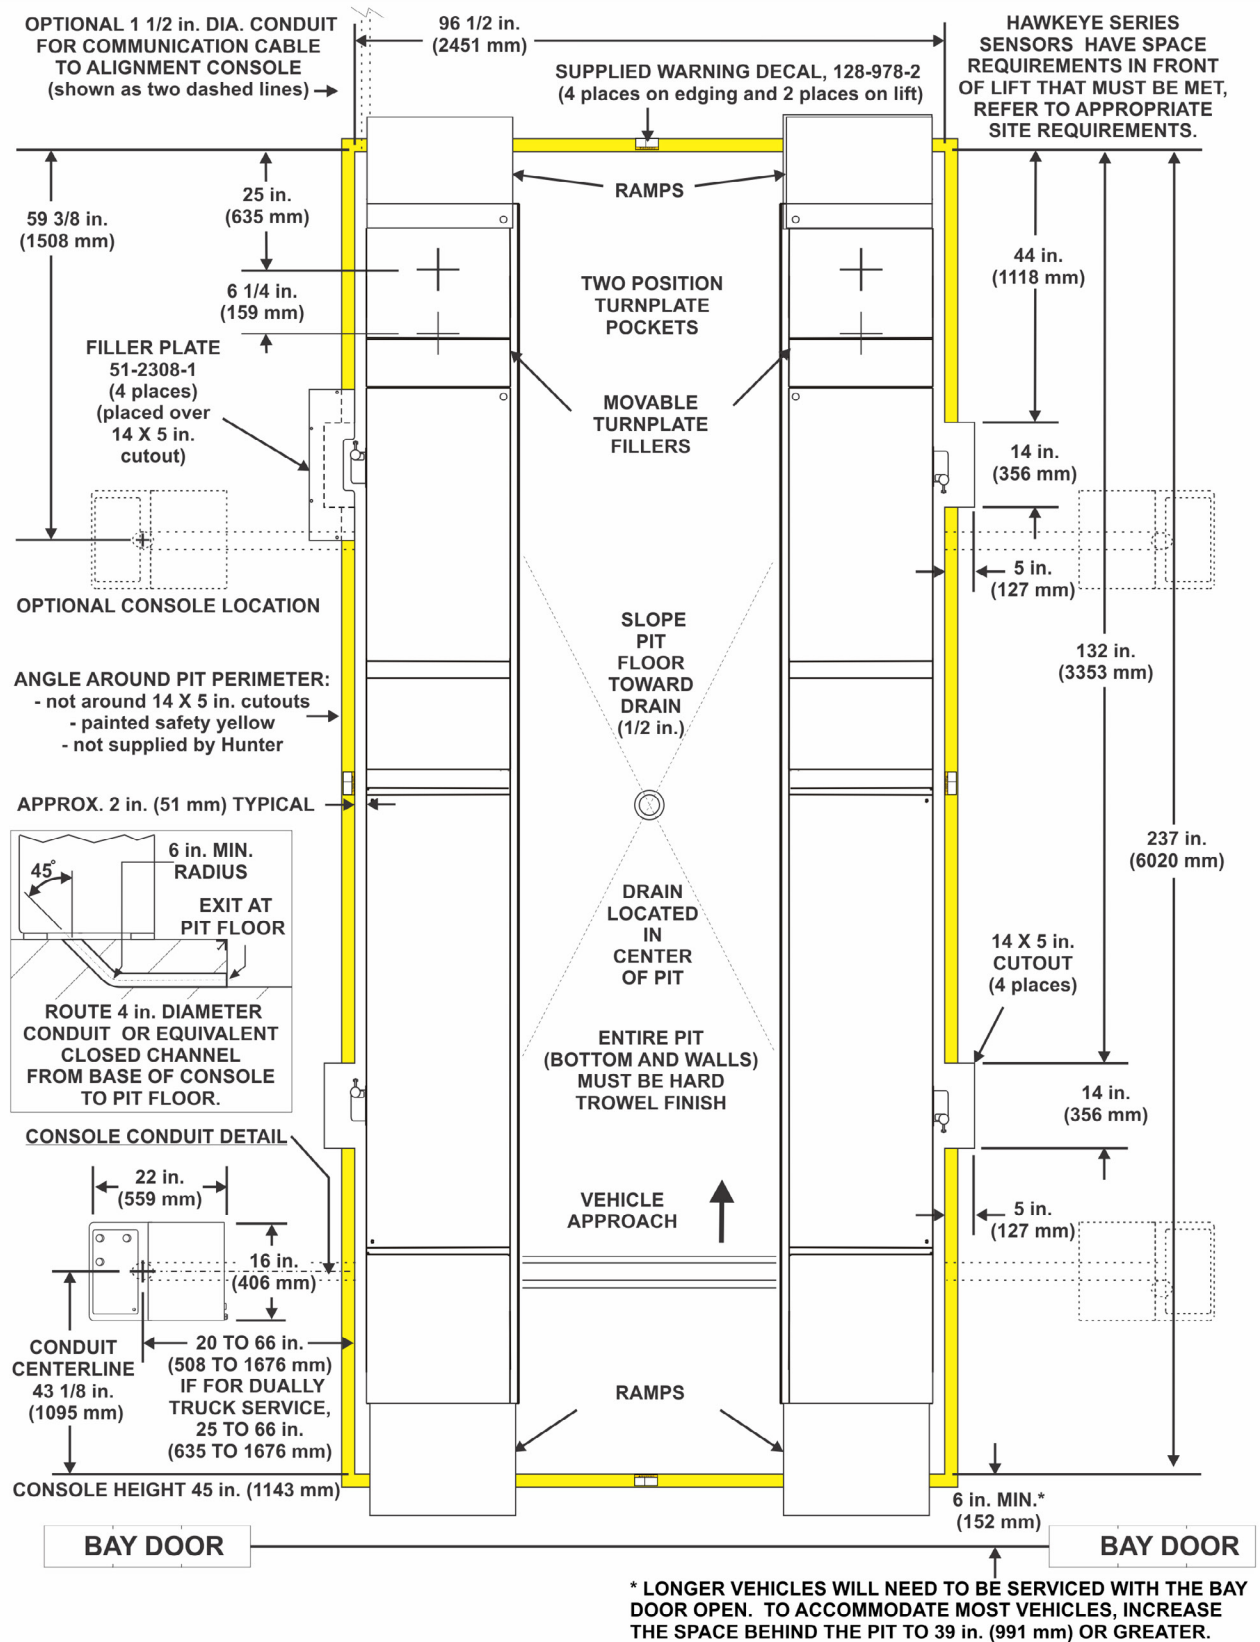

Dimensions shown are for end result. Tile thickness (if applicable) must be considered before pouring concrete. Positioning of control console is limited to a maximum space between console and rack of 5 1/2 feet (1676 mm) at the approach ramp end and 16 feet (4877 mm) at the turnplate end.